


Multi-drop Application example

HMI + HMI + PLC


Pere Roura



Network Configuration

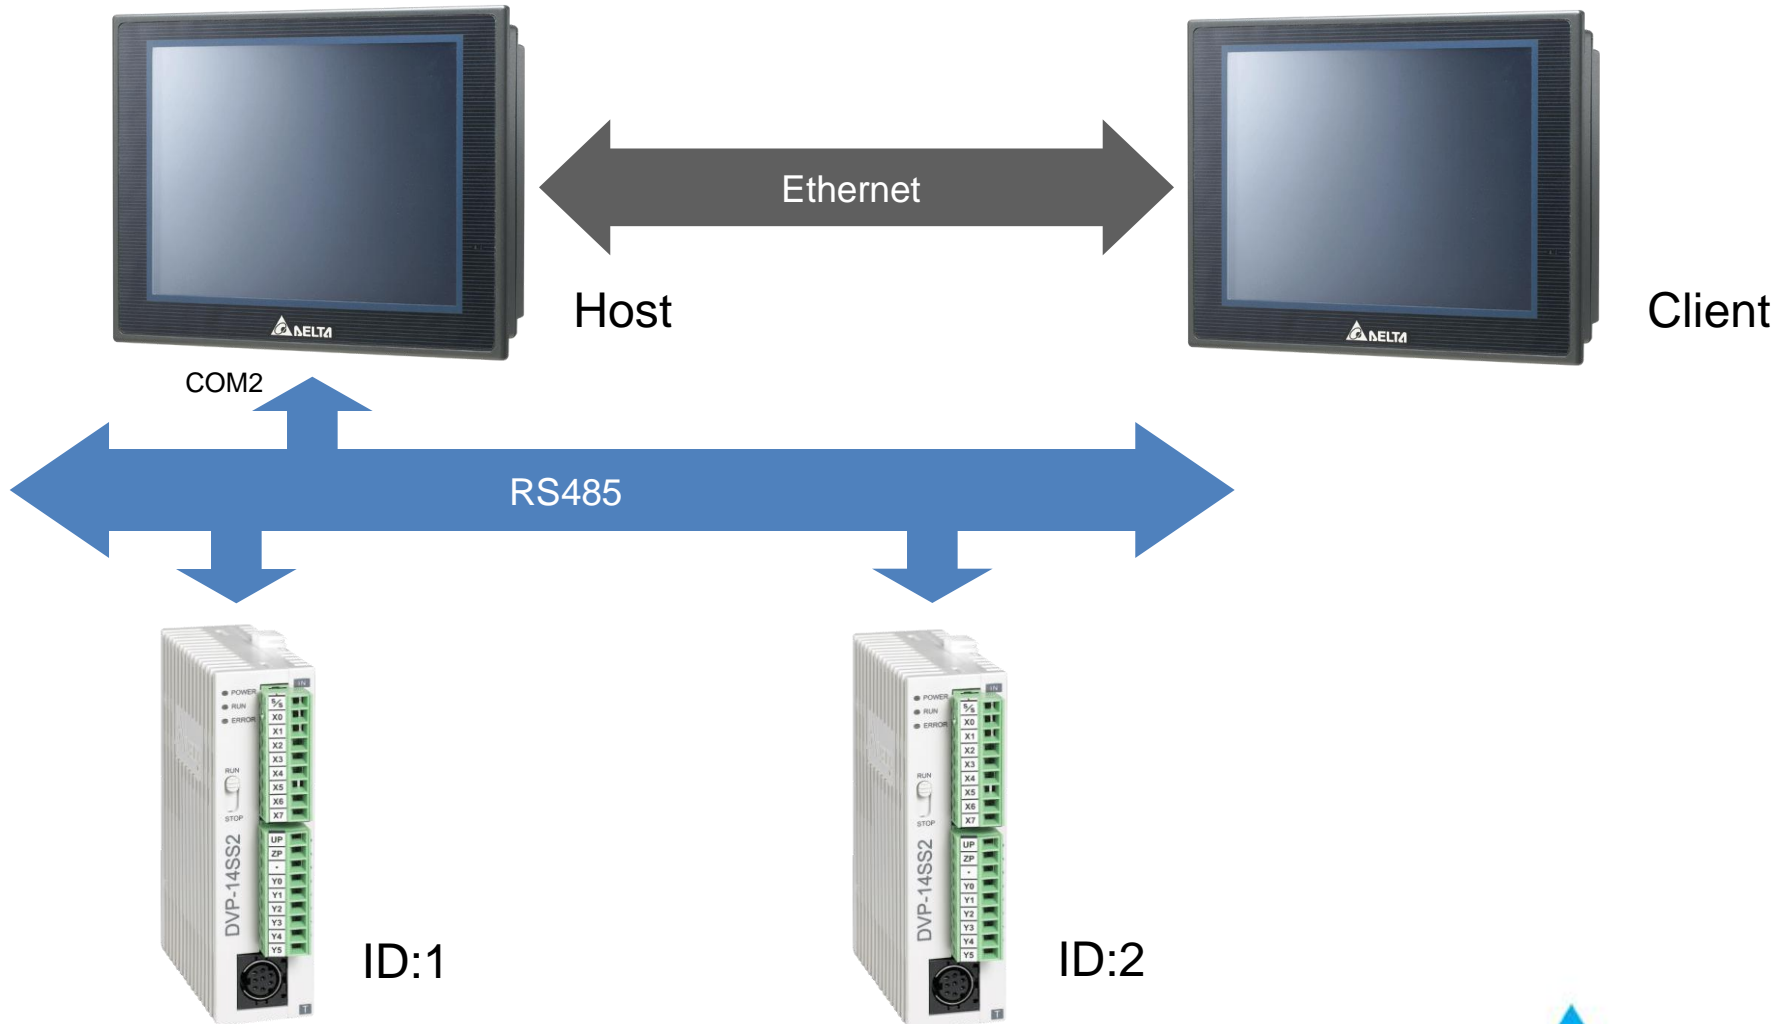


HMI Host Configuration 1

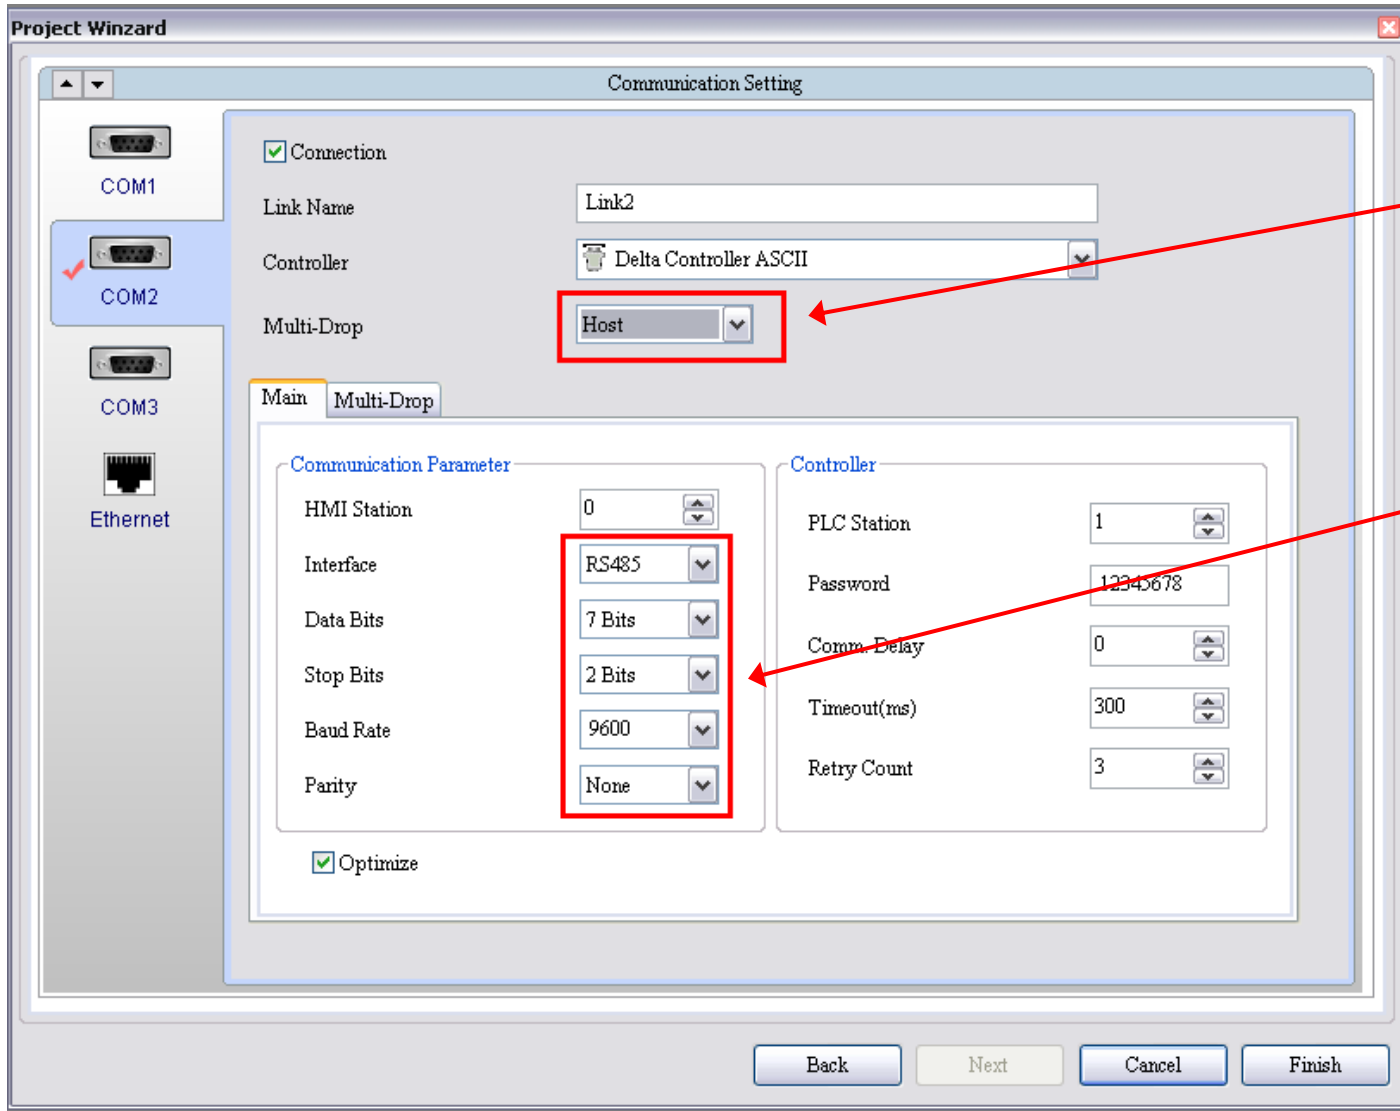

Host / Client

PLC port configuration

HMI Host Configuration 2

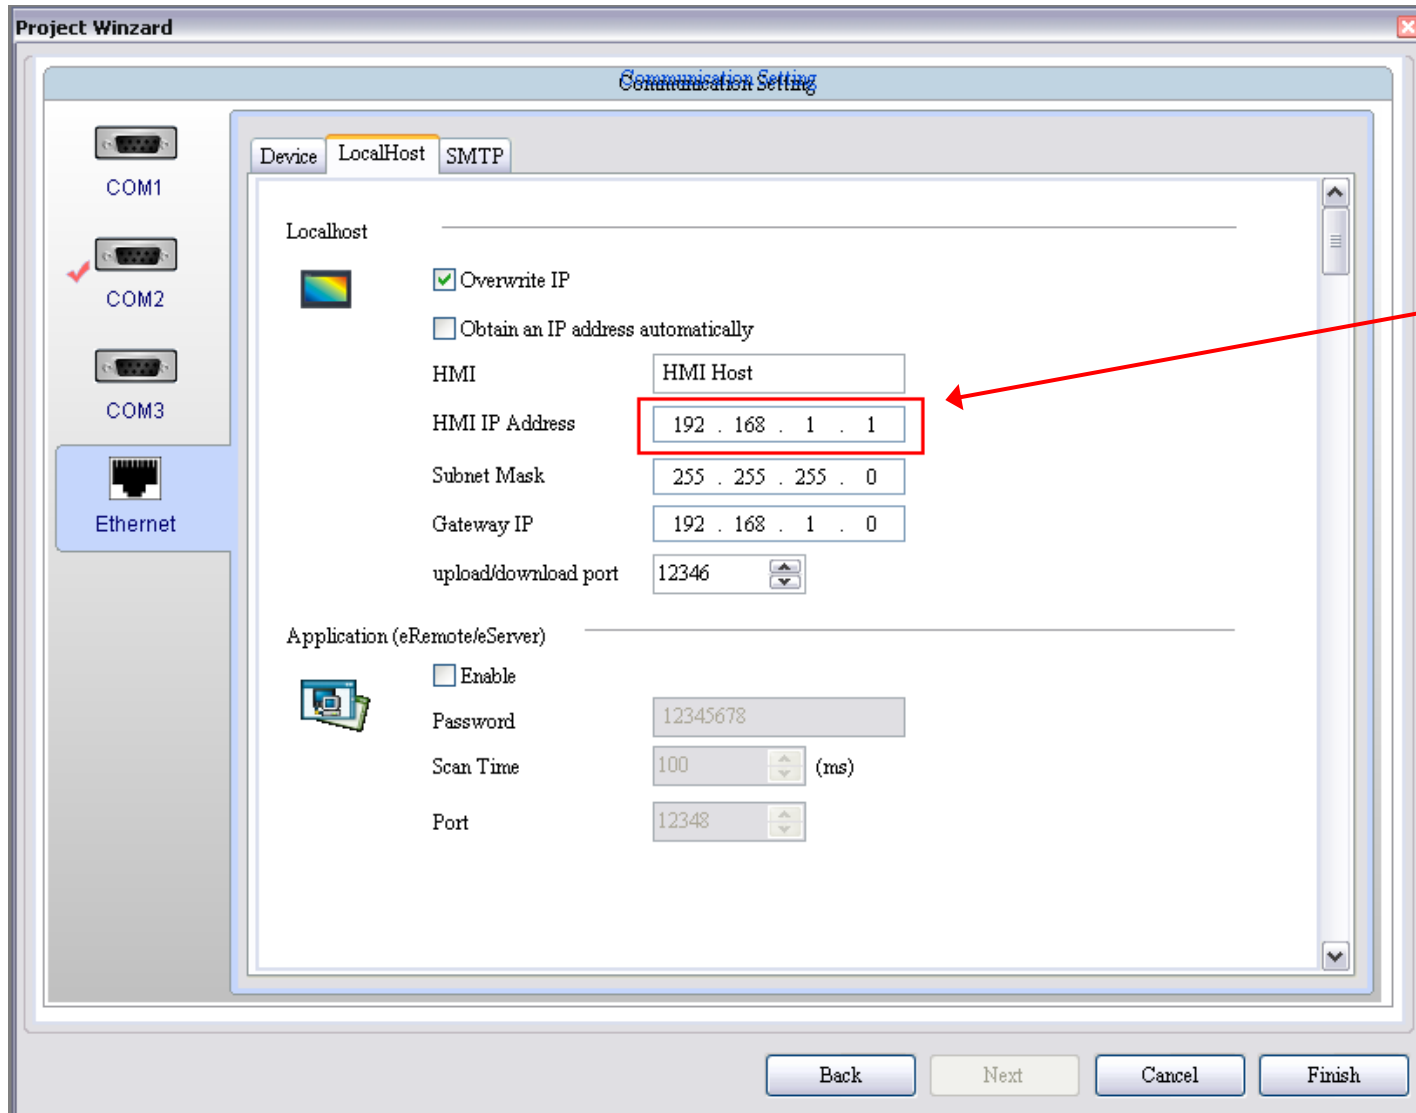

Host IP
address

HMI Host Configuration 3

Input

Link: Link2

Type

- Device (Word)
- Device (Bit)
- Internal Memory (Word)
- Internal Memory (Bit)
- Constant

Radix

- 10
- 10U
- 16

Station Number

2 Default

Content

Device Type: PLC_D

Address/Value: 0


Tag:

B	C	D	E	F	Clear
6	7	8	9	A	Back
1	2	3	4	5	Enter
0	:	+	-	/	
.	None				

PLC or another Delta device
(VFD, ASDA, etc...)

PLC Address
(Ad:1, Ad2, etc...)

HMI Client configuration

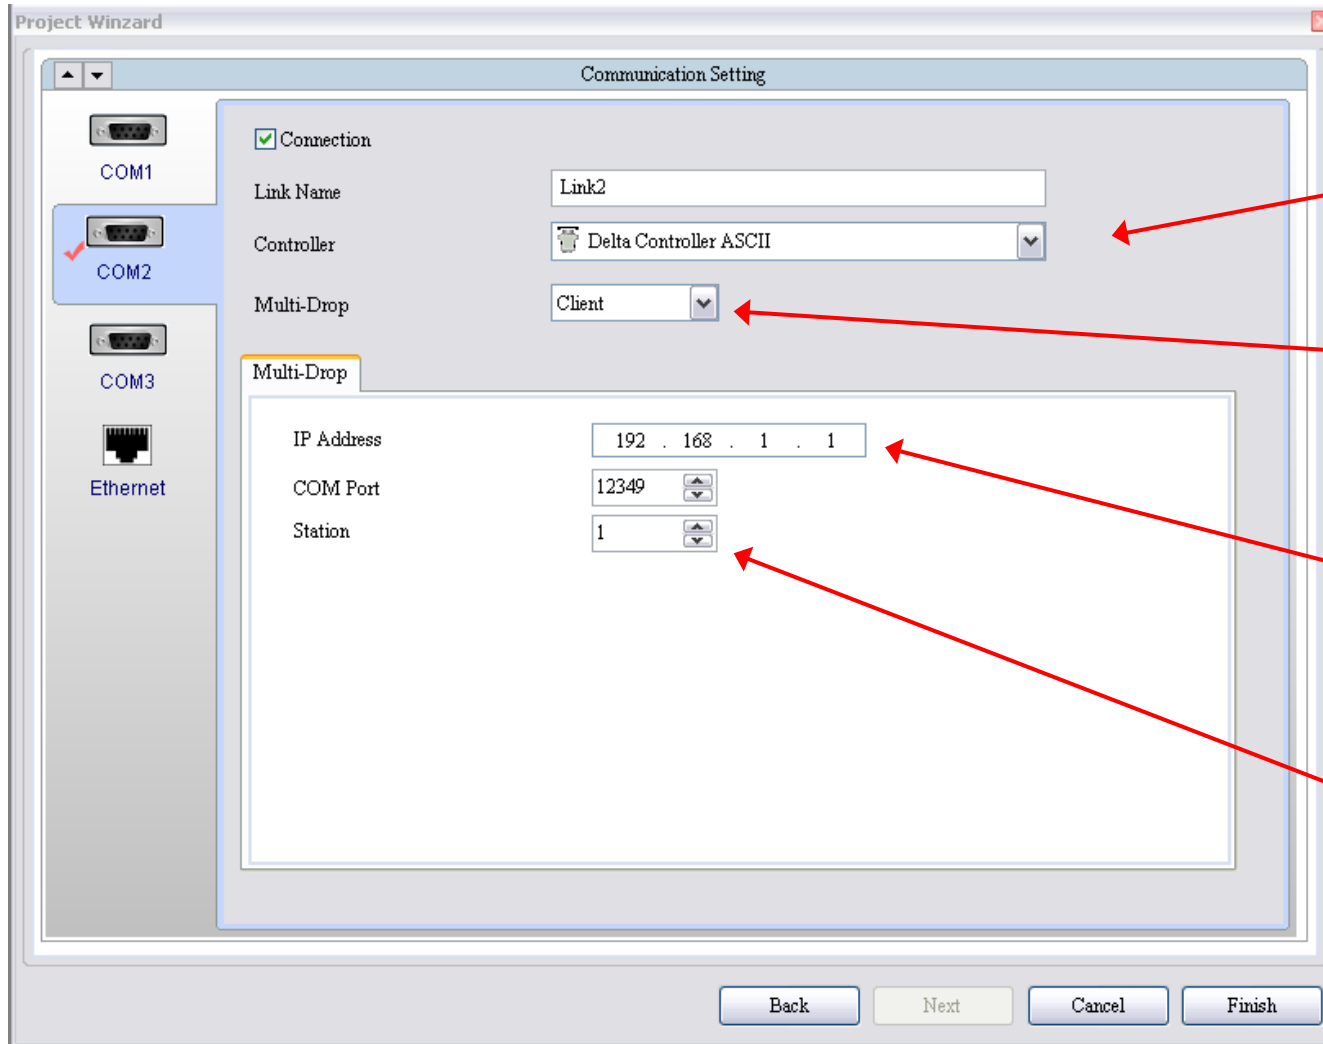

Same protocol

Host/Client

Host IP Address

PLC address

Thank you

To learn more about Delta
please visit www.deltaww.com

