


AS-i Communications System



Area of Use and Basic Properties



AS-i Cable

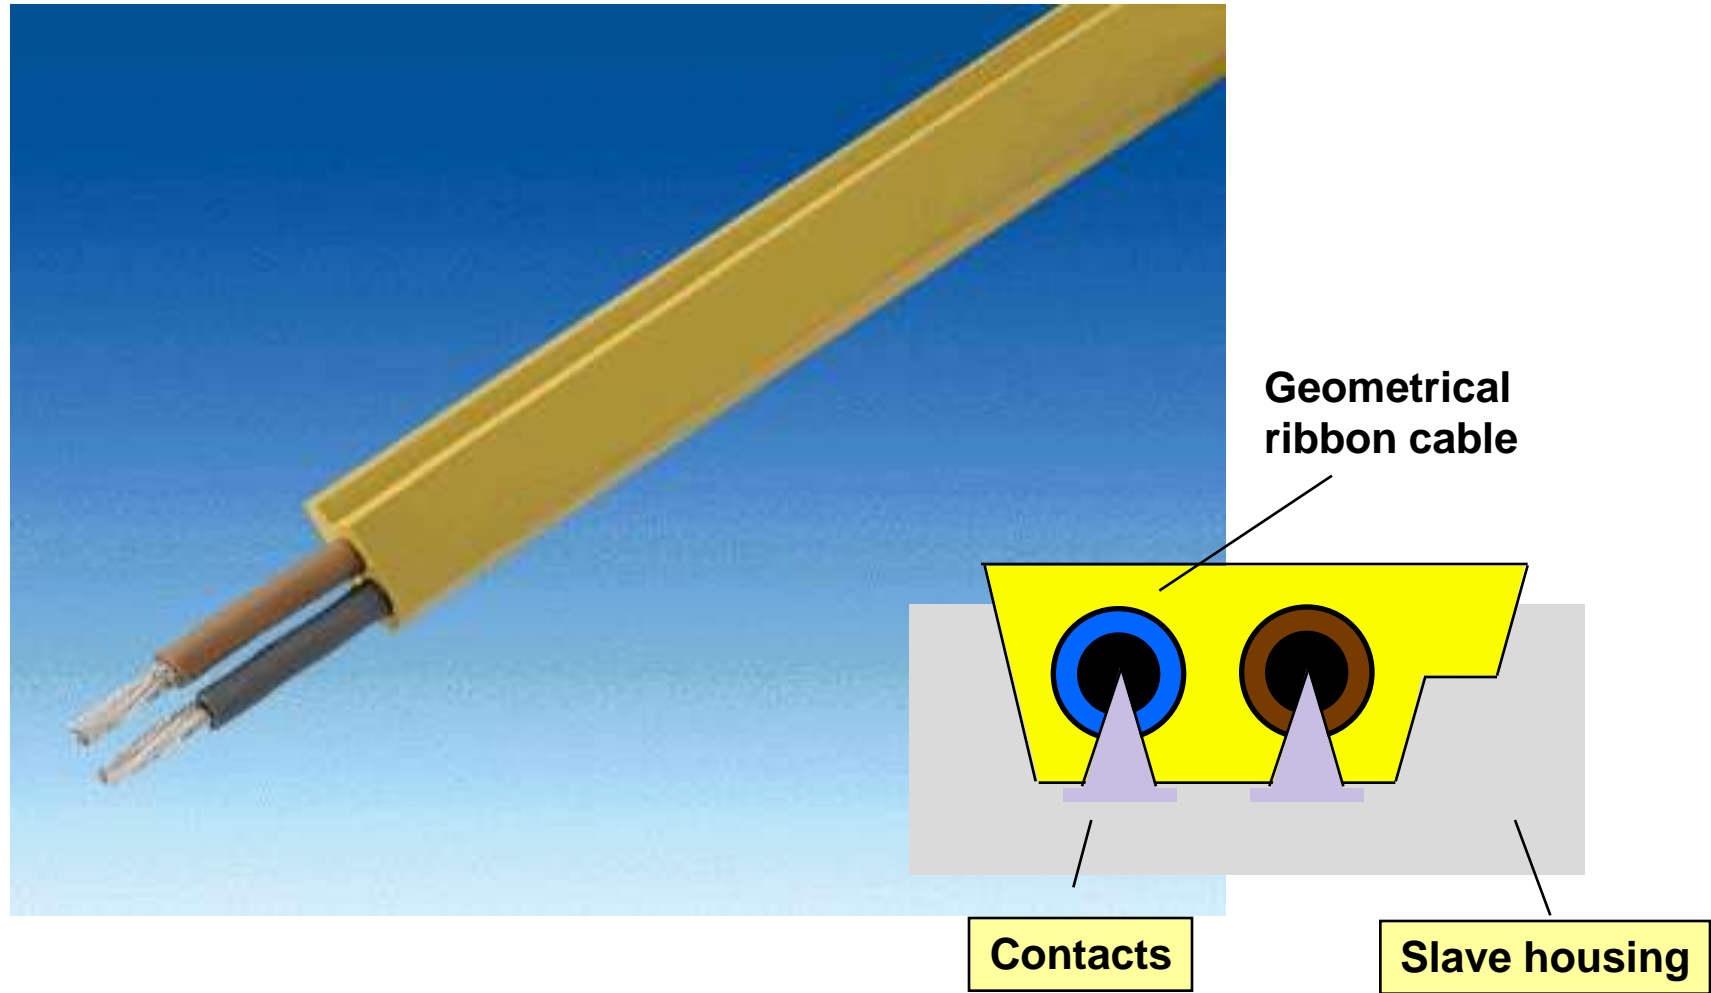

AS-i Modules

AS-i Bus


Compact Modules

Profibus DP

Analog Modules

Power Supply

DP/AS-i Link 20

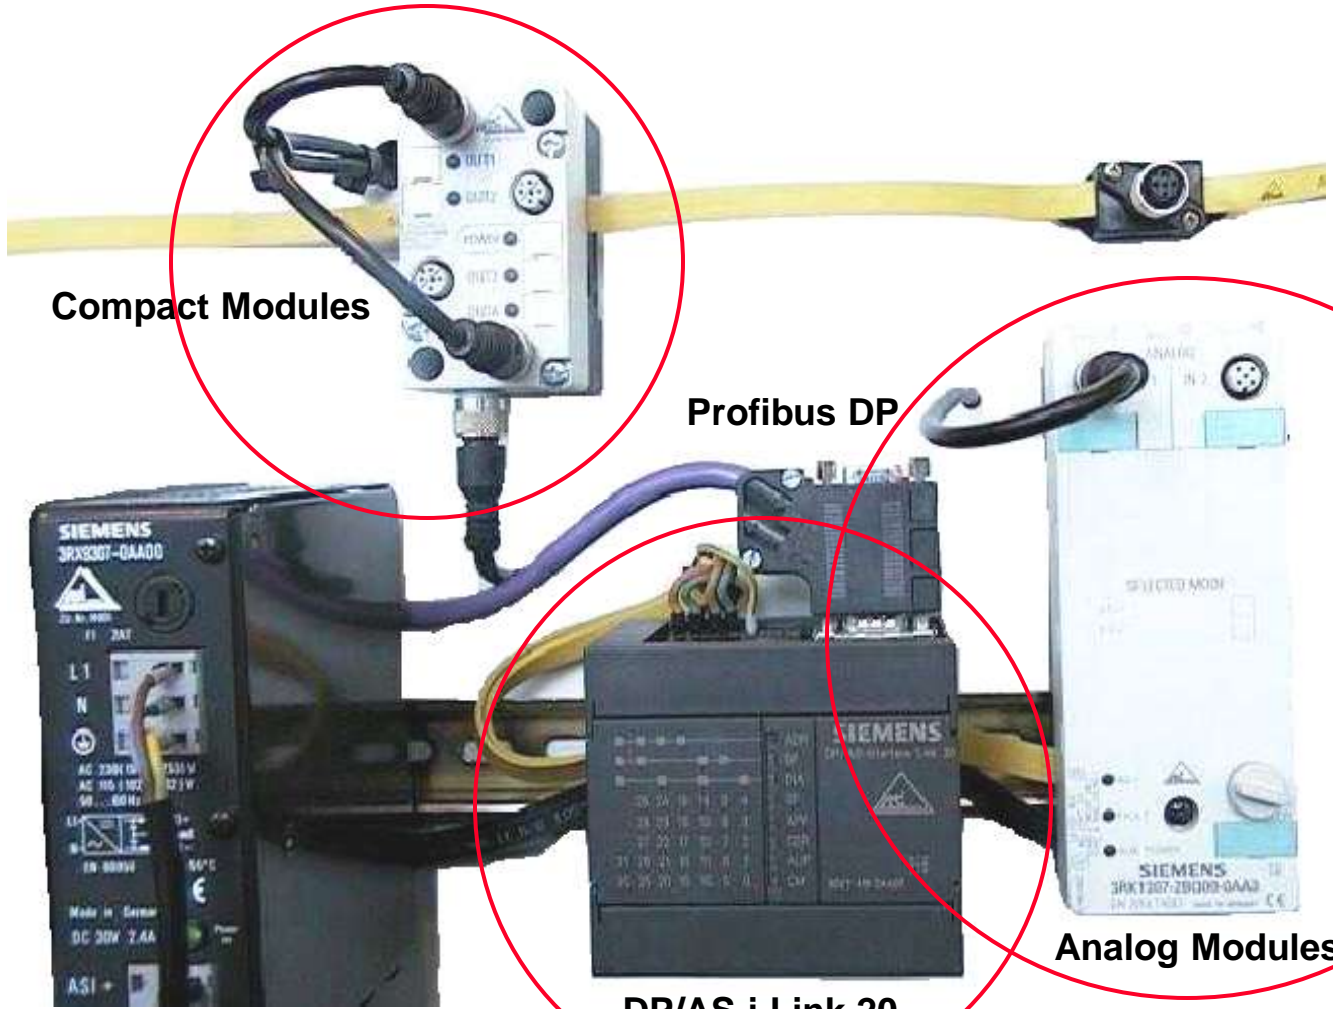

Hardware Configuration

HW Konfig - [S7-300 Station (Konfiguration) -- PRO1_K14_Analogwert]

Station Bearbeiten Einfügen Zielsystem Ansicht Extras Fenster Hilfe

(0) UR

1	PS 307 2A
2	CPU 315-2 DP
X2	DP
3	
4	DI32xDC24V
5	DO32xDC24V/0.5
6	DI8/DO8x24V/0.5
7	AI2x12Bit
8	
9	

PROFIBUS_K14: DP-Mastersystem (1)

Profibus Slave AS-i Master

(4) IM151-1 (6) MICROM (100)

(100) DP/AS-i Link 20E

AS-i Adr.	Baugruppe	E-Adresse	A-Adresse	ID-Code	ID-Code	ID1-Code	ID2-Code	Komm...
	DP/AS-i	24...39	24...39					
1A	DP/AS-i Link 20E							

Drücken Sie F1, um Hilfe zu erhalten.

Änd

Addressing AS-i slaves

(100) DP/AS-i Link 20E

AS-i Adr.	Baugruppe	E-Adresse	A-Adresse	ID-Code	ID-Code	ID1-Code	ID2-Code	Komm...
	DP/AS-i	24...39	24...39					
1A	DP/AS-i Link 20E							

Drücken Sie F1, um Hilfe zu erhalten.

Änd

